
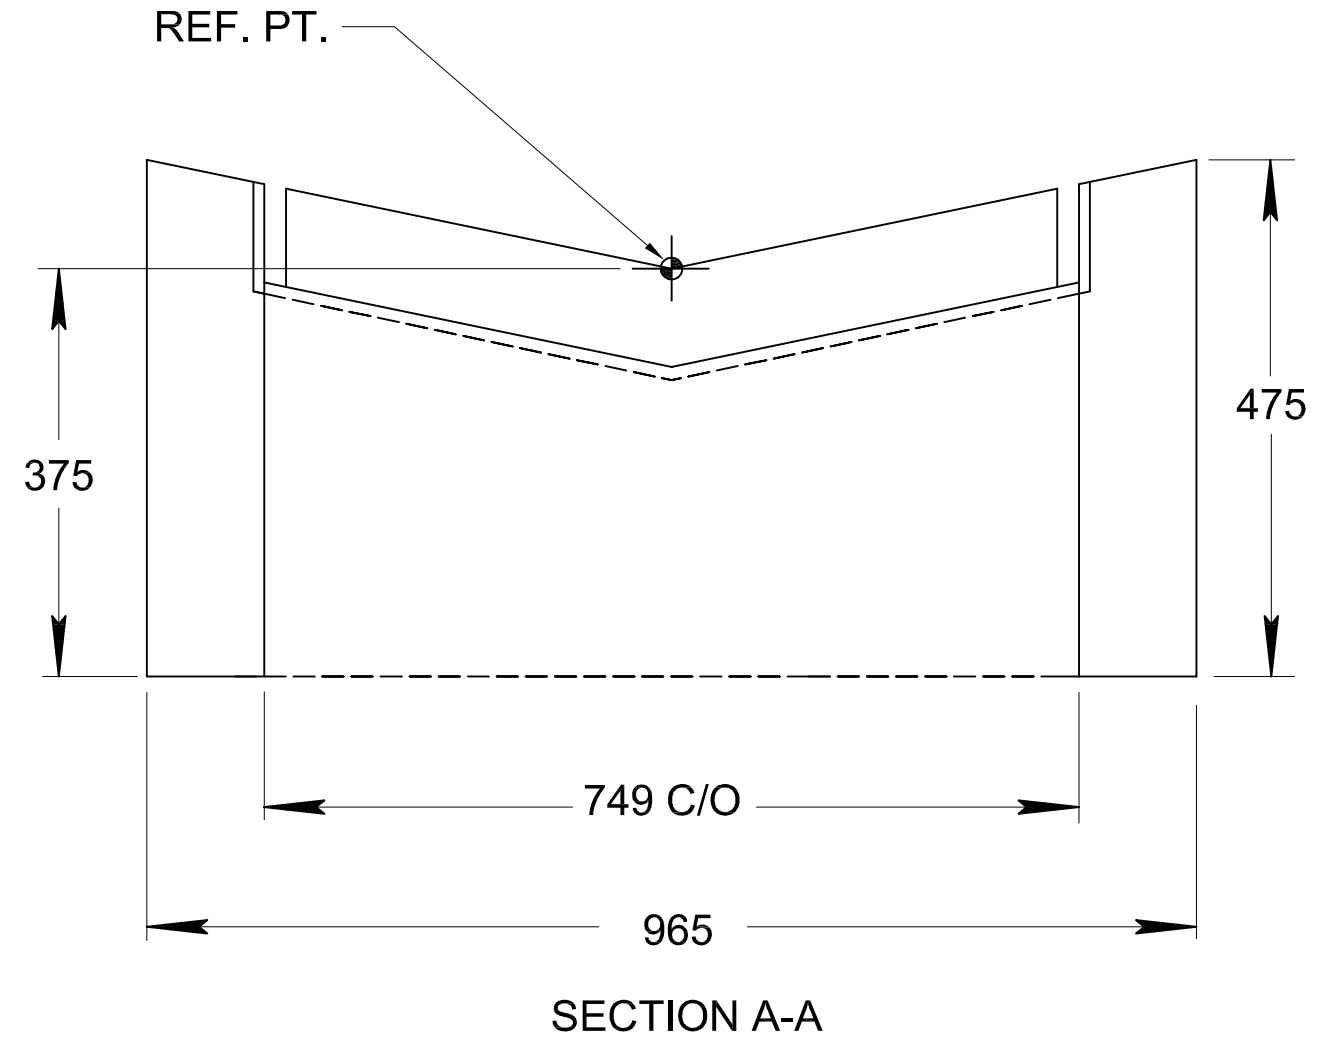


NOTES

1. CONCRETE STRENGTH TO BE 50MPa MINIMUM AT 28 DAYS.
2. REINFORCEMENT IN ACCORDANCE WITH AS4671.
3. TYPE SO GRATE TO BE CLASS D AND BICYCLE SAFE IN ACCORDANCE WITH AS3996-2006.
4. ALL DIMENSIONS ARE IN MILLIMETRES U.N.O.

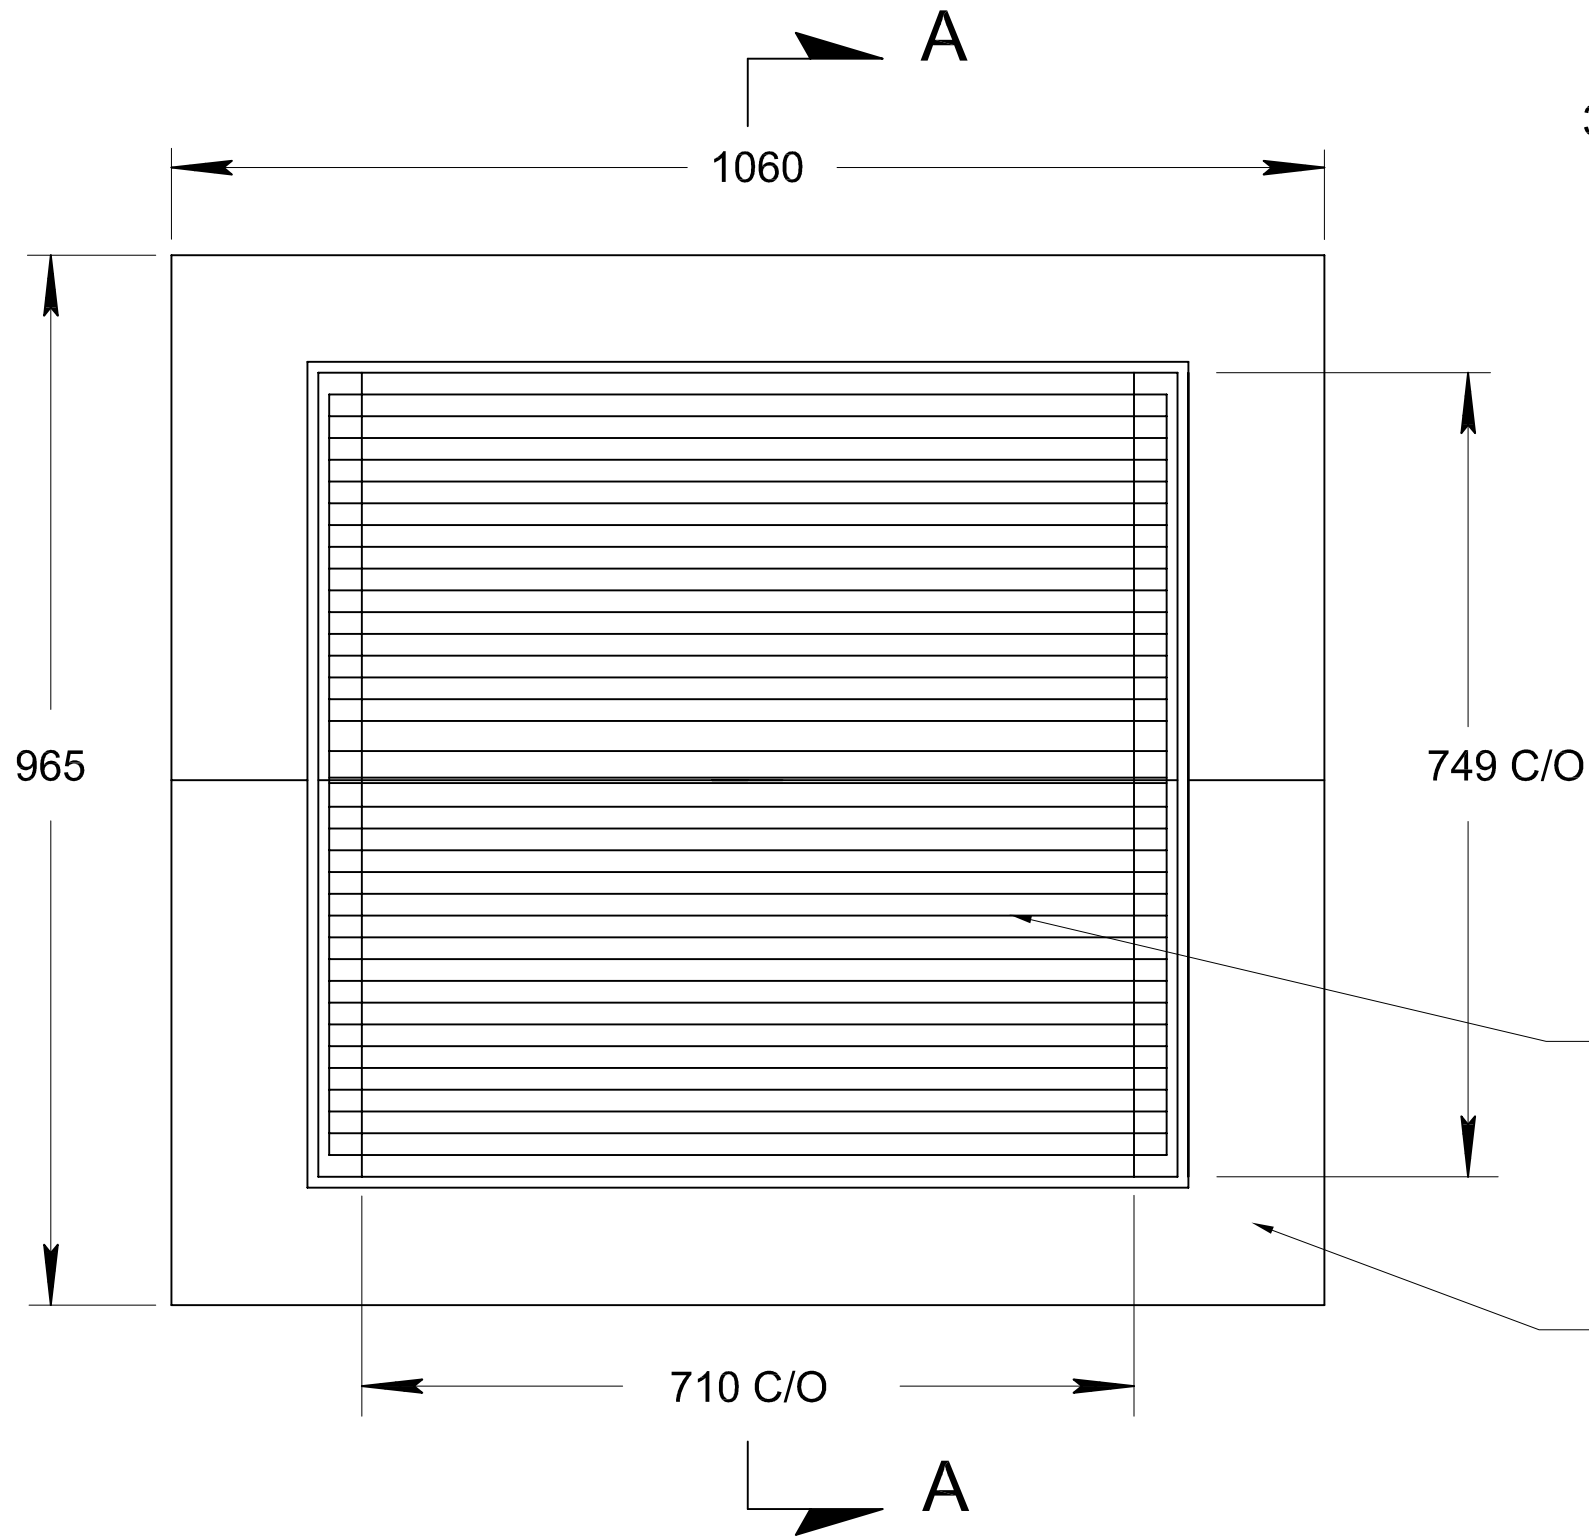

CLASS D TYPE SO
GRATE & FRAME

CONCRETE TOPSLAB
ENCASING FRAME

DRW. NOT TO SCALE

REVISION	DATE	INITIALS	DETAILS
	NOV 09		INITIAL DESIGN

Aus Pits

STANDARD DRAWING			
SO1 GRATE ENCASMENT			
TYPICAL DETAILS			
DRAWN BY: G.J.F.	APPROVED: P. MOULTON	DRG NO: AP-SD-C-020	REV: 0