



NOTES

1. CONCRETE STRENGTH TO BE 50 MPa
2. REINFORCEMENT TO COMPLY WITH AS4671 & AUS PITS COMPUTATIONS
3. ALL DIMENSIONS ARE IN MILLIMETRES U.N.O.
4. DRAWINGS ARE NOT TO SCALE
5. STEP IRONS JFH255 OR EQUIVALENT ARE TO BE INSTALLED TO PROJECT REQUIREMENTS
6. FOR PIT SIZES AVAILABLE, PLEASE REFER TO TABLE OF PIT SIZES IN THE AUS PITS CATALOGUE

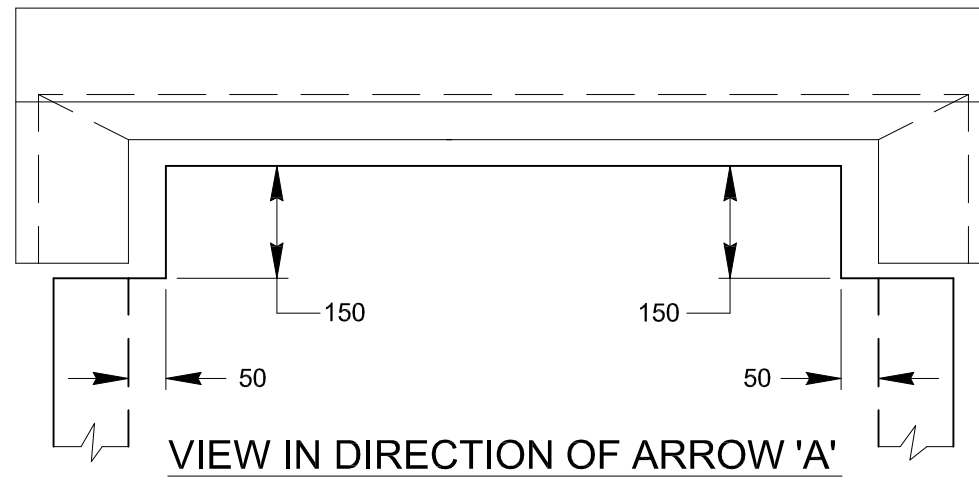


FRAME & GRATES INSTALLED BY OTHERS ONSITE

TO PROJECT AND AUTHORITY REQUIREMENTS

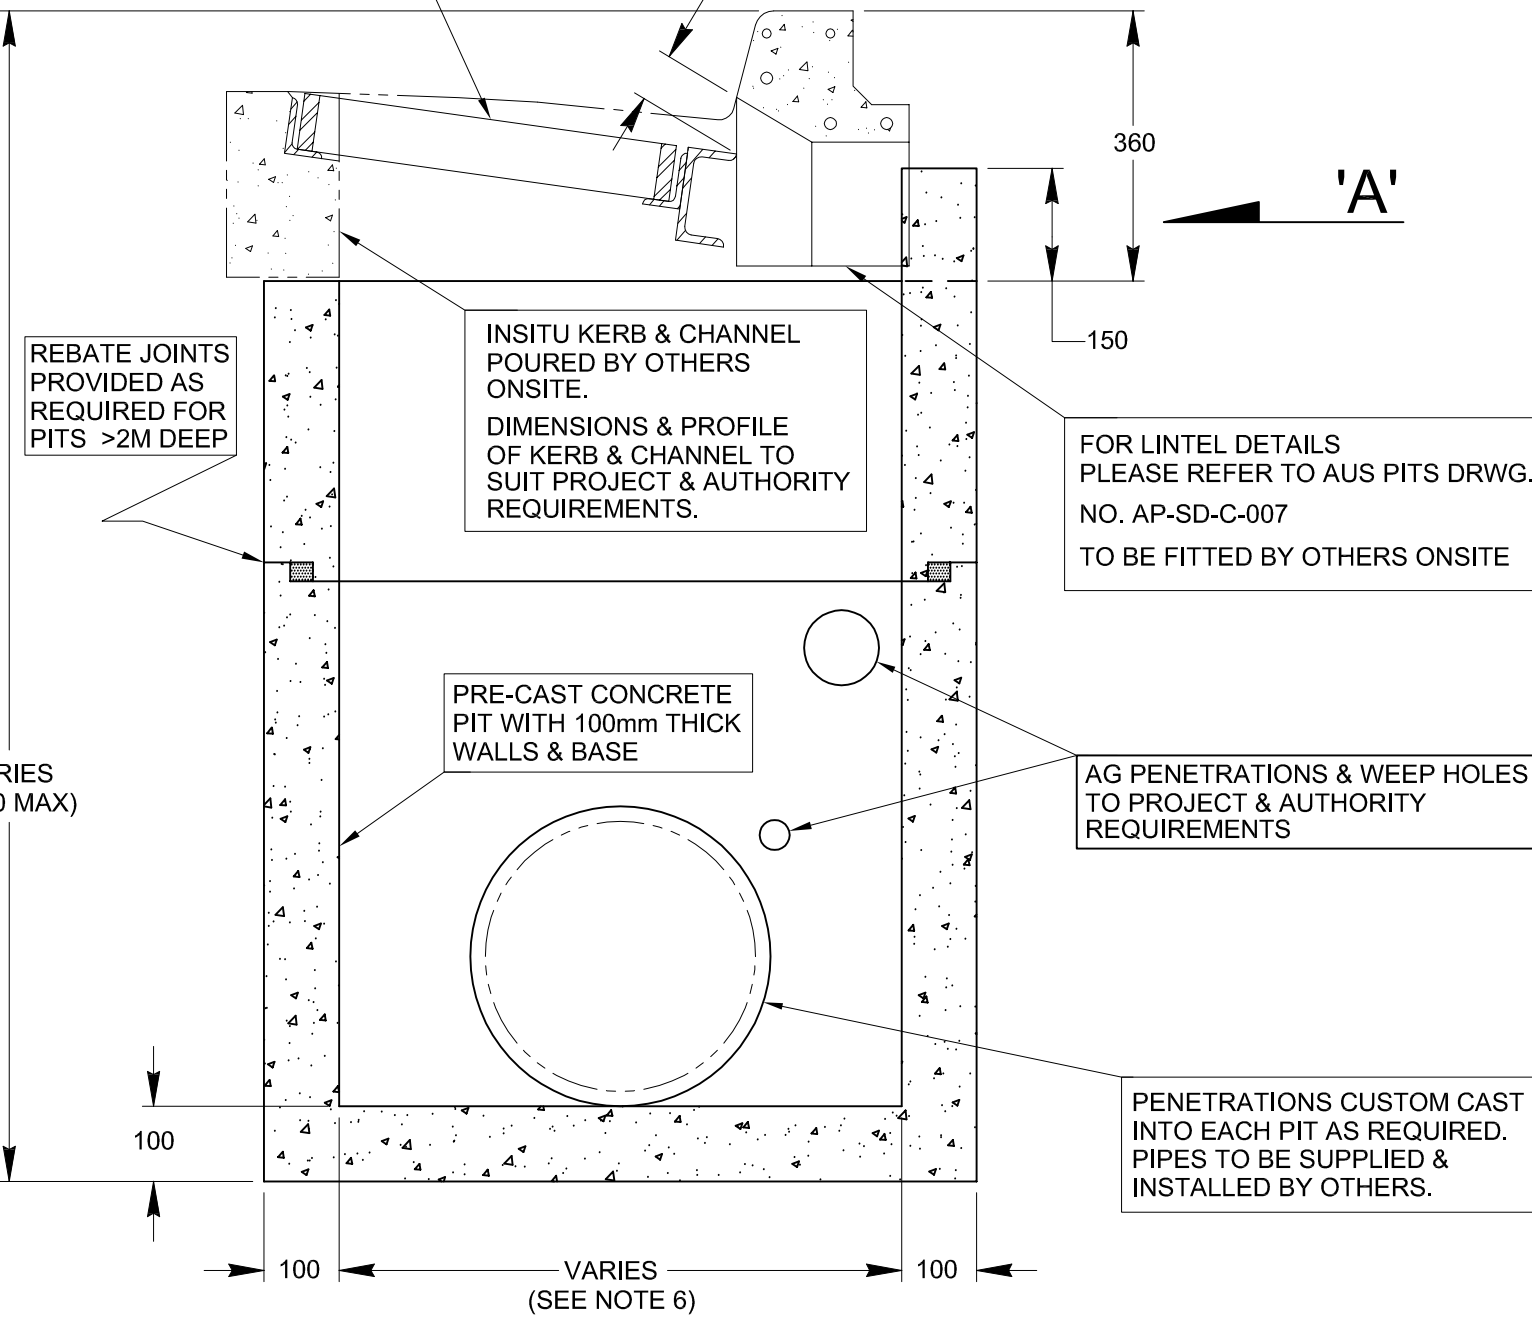


PENETRATIONS CUSTOM CAST INTO EACH PIT AS REQUIRED. PIPES SUPPLIED & INSTALLED BY OTHERS ONSITE

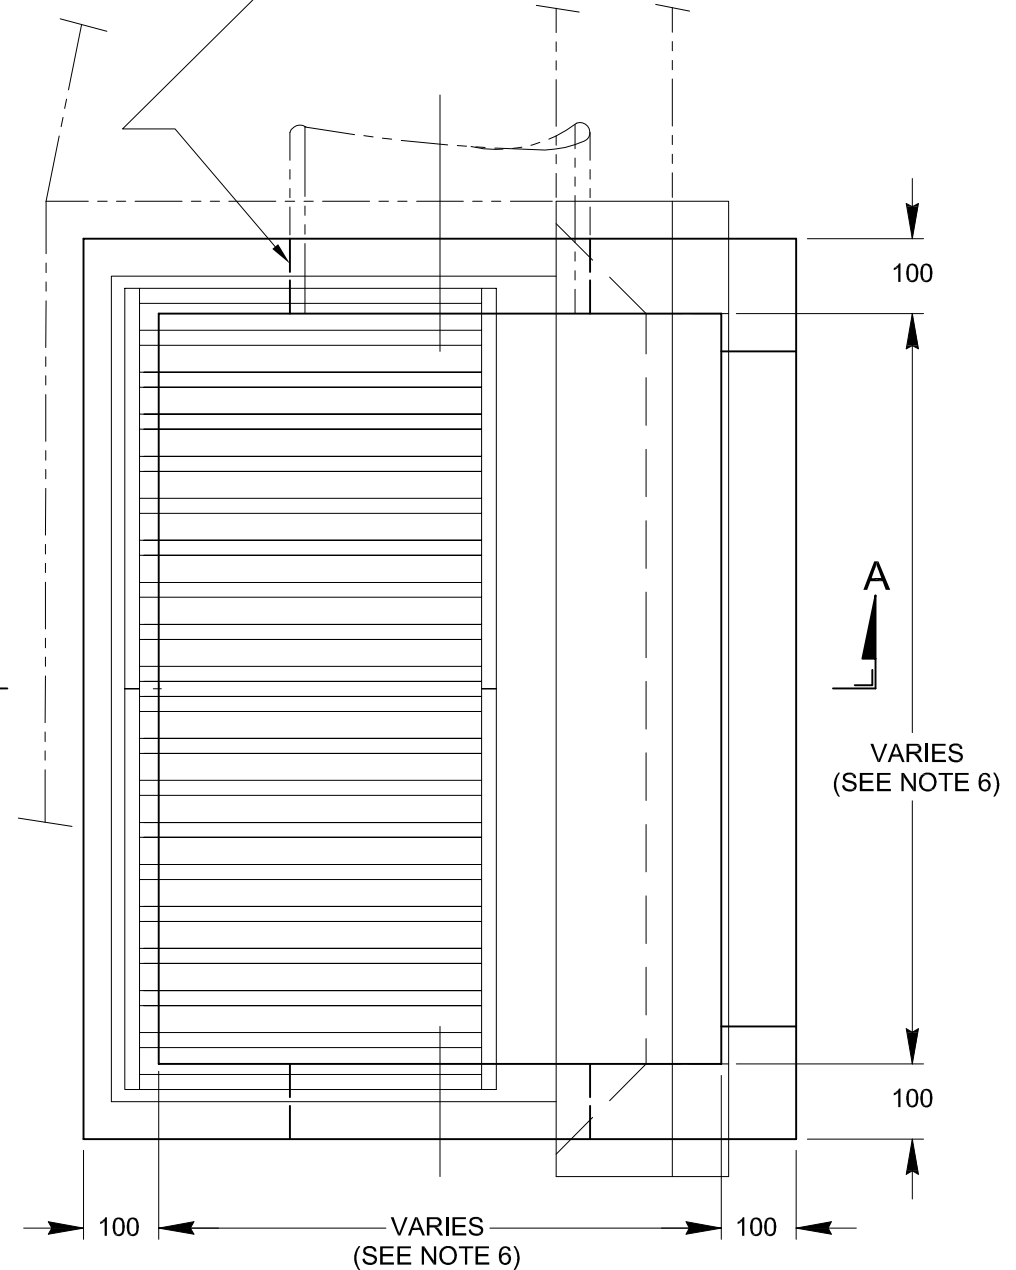

DWG. NOT TO SCALE

REVISION	DATE	INITIALS	DETAILS
	JUL 09		INITIAL DESIGN

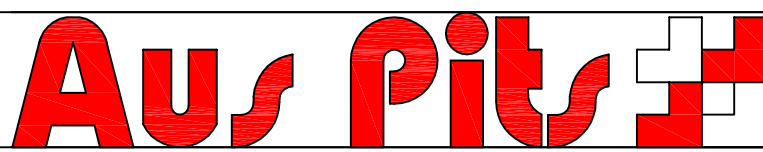

STANDARD DRAWING			
GRATED SIDE ENTRY PIT TO SUIT VICROADS SD 1322			
TYPE 'B' BARRIER LINTEL - TYPICAL DETAILS			
DRAWN BY: G.J.F.	APPROVED BY: P. MOULTON	DRG NO. AP-SD-SW-014	REV: 0