



NOTES

1. CONCRETE STRENGTH TO BE 50 MPa
2. ALL DIMENSIONS IN MILLIMETRES U.N.O.
3. DRWGS ARE NOT TO SCALE
4. REINFORCEMENT IN ACCORDANCE WITH AS4671 AND AUS PITS COMPUTATIONS
5. STEP IRONS JFH255 OR EQUIVALENT ARE TO BE INSTALLED TO COUNCIL REQUIREMENTS
6. FOR PIT SIZES AVAILABLE, PLEASE REFER TO TABLE OF PIT SIZES IN THE AUS PITS CATALOGUE

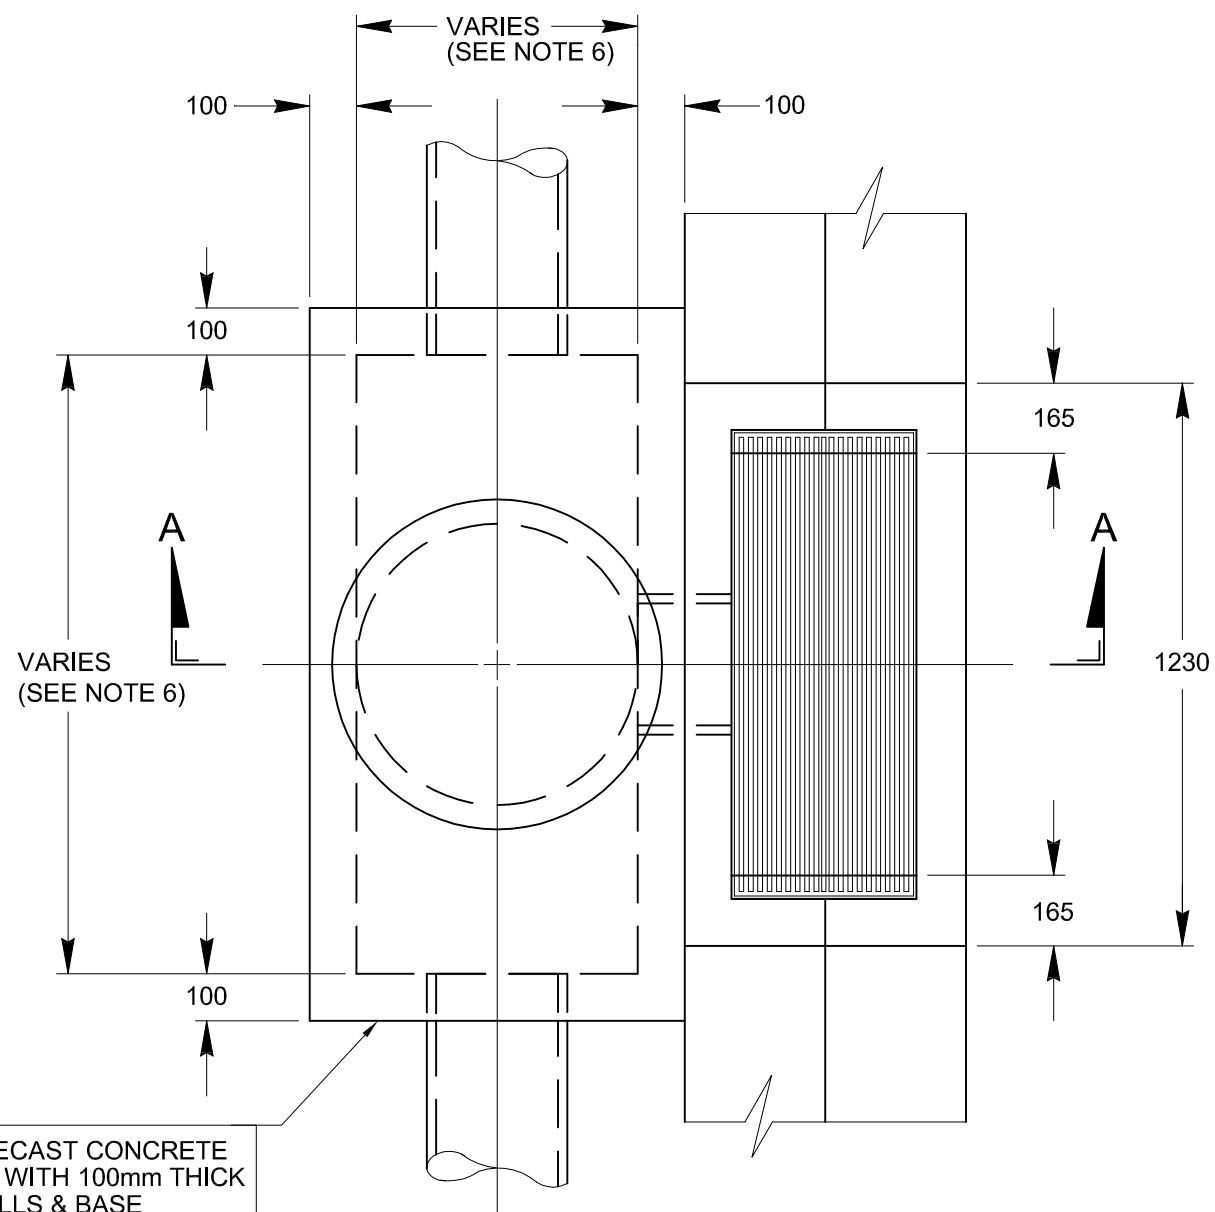


PLAN VIEW

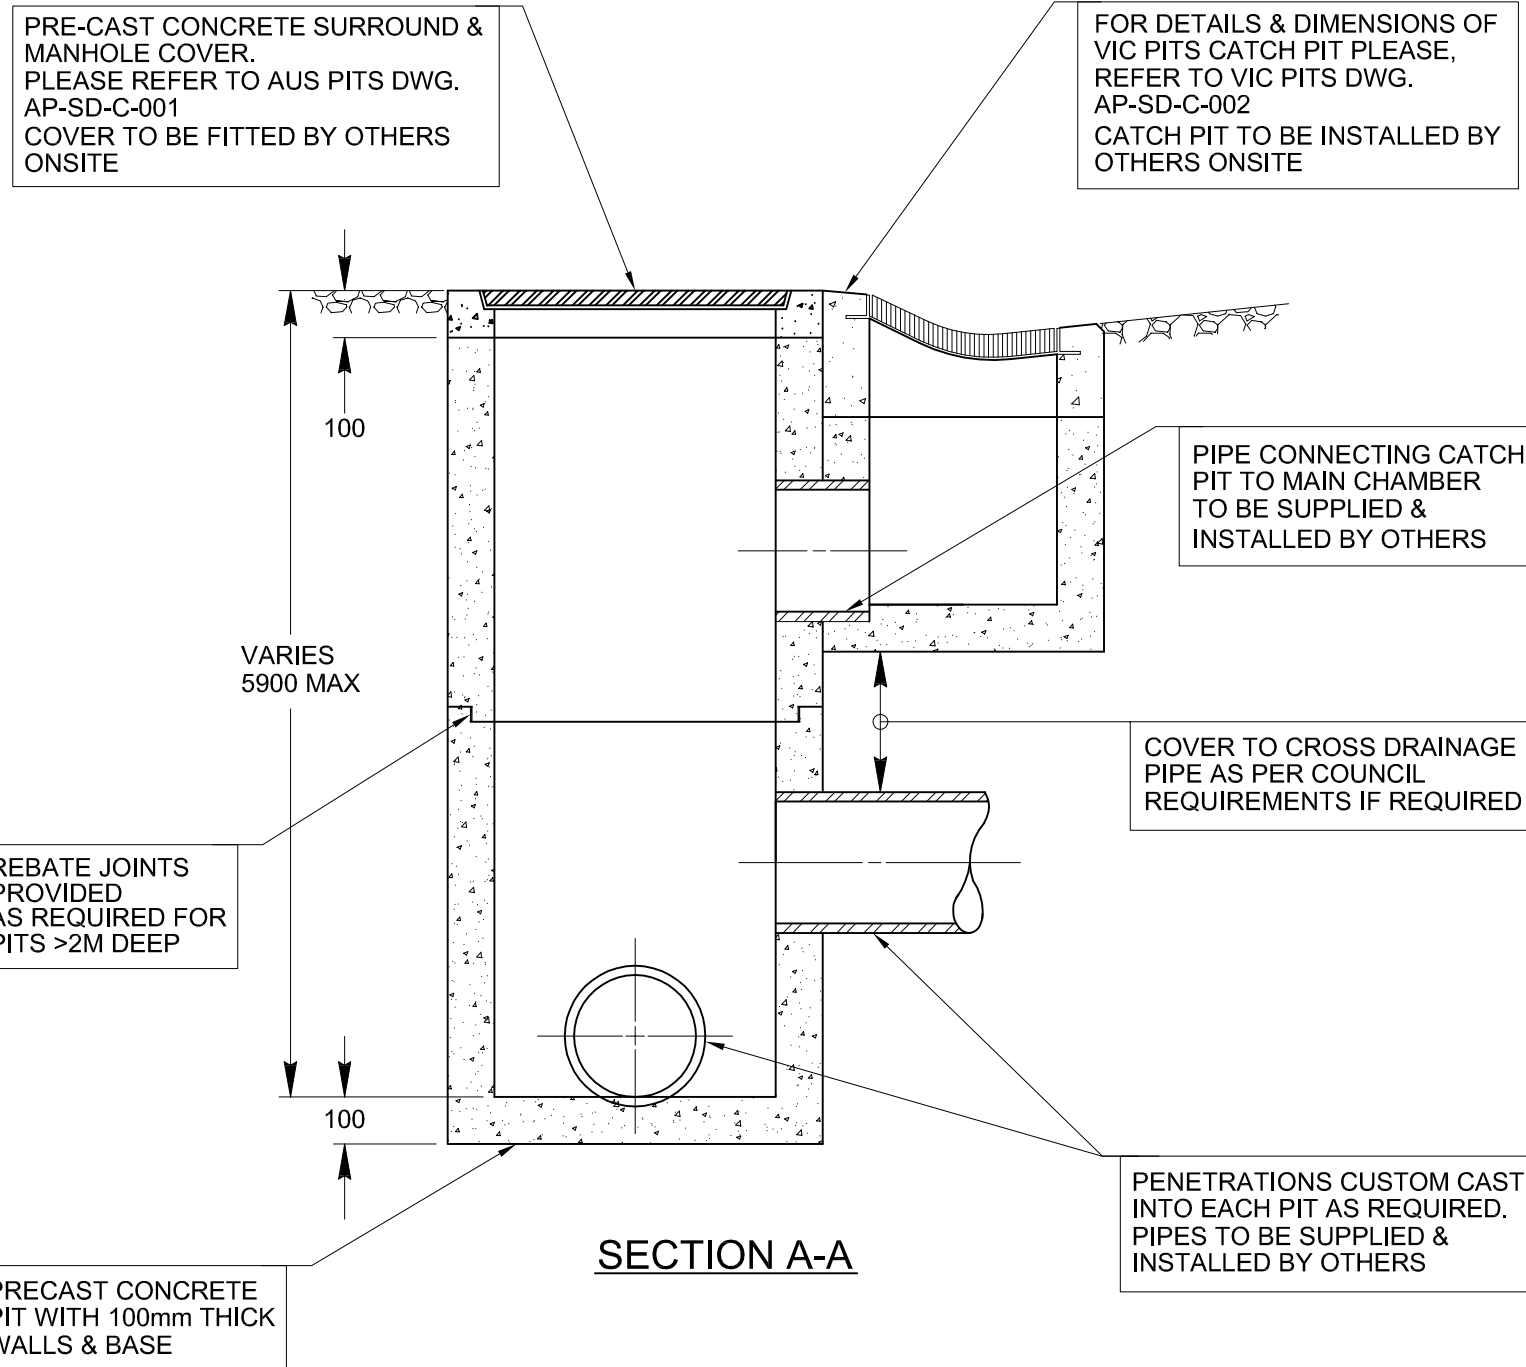

SECTION A-A

DWG. NOT TO SCALE

REVISION	DATE	INITIALS
	JUL 09	

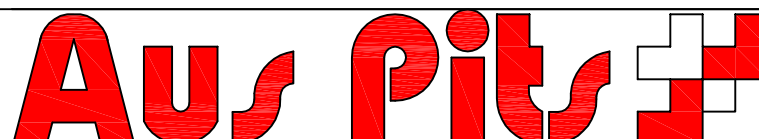

STANDARD DRAWING			
AUS PITS GSEP TO SUIT WYNDHAM CITY COUNCIL SD5-13(I)			
TYPICAL DETAILS			
DRAWN BY: G.J.F.	APPROVED BY: P. MOULTON	DRG NO: AP-SD-SW-018	REV: 0